AUTO-TUNE PID TEMPERATURE CONTROLLER


General Specification

- μP based, PID temperature controller with OUT and ALARM outputs
- Auto-tuning for PID parameters
- Sensor type: T/C (J,K,T,S,R), Pt100, selectable, multi-input
- Selectable control type: P, PI, PD, PID or ON-OFF
- Automatic "Overshoot" elimination in PID mode "Anti-windup"
- "Anti-windup"
- Upper and Lower limit for SET and ALARM settings
- Selectable relative, absolute or band alarm
- ON-delay for OUT in cooling mode
- Displays SET and PROCESS values
- Cold-junction compensation for T/C
- Line compensation for Pt100
- Excellent linearity with °C/mV and °C/W look-up tables
- Input "Offset" feature
- Password protection
- High accuracy
- FEPROM memory to store settings
- Optional SSR output
- Easy connection with plug-in connectors

Connection

Marning: If 2 wire Pt100 is used, connect compansation lead to measuring lead.

[DT-96/ DT-Y/DT-D: 17-18, DT-72: 13-14, DT-48: 10-11]

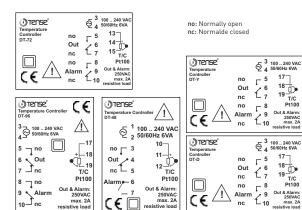

1

MADE IN TURKEY

Technical Specification

DT-96:96x96, DT-72:72x72, DT-48:48x48, DT-D, DT-Y:48x96mm Dimension

Display : 4 Digits 7 Segment (PV), 4 digits 7 Segment (SV)

Sensor Type

J,K,T,S,R type T/C, Pt100 selectable -100 .. 600 °C, J type T/C, (Inpt=J), -100 .. 1300 °C, K type T/C, (Inpt=k) Measuring Scale -100 .. 400 °C, T type T/C, (Inpt=t), 0 .. 1750 °C, S type T/C, (Inpt=S)

0 .. 1750 °C, R type T/C, (Inpt=r), -100 .. 600 °C, Pt100, (Inpt=Pt)

-99.9 .. 600.0 °C, Pt100, (Inpt=Pt.0)

 Resolution : ±1°C or ± 0.1°C ± % 0.3 (Over full scale) Accuracy

 Control Form ON-OFF or P.PI.PD.PID - selectable

Relay (NO + NC), 250VAC, 2A, Resistive load, (optional SSR) Out Output Relay (NO + NC), 250VAC, 2A, Resistive load, (only NO for Dt48) Alarm Output

 Heat SET Lower Limit .. Upper Limit °C (H.Set) Alarm SET

 $\label{eq:all:to_all} $$AL.tY = Abs, -Abs; Lo.L .. UP.L ^C (A.Set) $$AL.tY = rel, -rel, bnd, -bnd, bn.i, -bn.i; -100 .. +100 / -10.0 .. +10.0 (Pt.0) $$$

 Heat Hysteresis $0...50\,/\,0.0...5.0\,^{\circ}\text{C}$ (H.Hys); PID is active if set to 0

 $50 \, / \, 0.1 \ldots 5.0 \, ^{\circ}\text{C} \; \text{(A.Hys)}$ Alarm Hysteresis Proportional Band : 1 .. 130 °C (Pb.C) Integral Time 0 .. 30,0 min. (OFF if set to 0)

0.. 10,0 min. (OFF if set to 0) Derivative Time Control Period 4 .. 200 sec (Ct)

-100..+100 °C / -10.0 .. +10.0 (oFFS) Offset

Selectable (only ON-OFF control form is active for cooling) Heating/Cooling

Cold. Junc. Comp. 0... 50 °C (T/C)

Line Comp. 10 0hm maks. (3 wire Pt100) Operation Temp -20°C... 50 °C

Supply Voltage 100...240VAC, 50/60Hz Power Consump. < 6VA Weight < 0.5 kg

 Altitude < 2000 m ALARM output is always OFF, OUT output is active according to P.Err and Ct parameters in case of sensor failure, measurement out of range or hardware fails to measure input signal (OUT output is OFF if Perr is 0)

Error Message:

 Displays "FAiL" message in case of sensor failure, measurement out of range or hardware fails to measure input signal.
 Hardware failure. FAIL:

Err

<u>Marning:</u>

Use shielded and twisted signal cables and connect shield to ground on device side. Use correct compensation cables for T/C sensors. Connect T/C cable directly to the device connectors. Keep all signal cables away from contactors, devices/cables emitting electrical noise, power cables.

Keep device away from contactors, devices/cables emitting electrical noise, power cables. Take precautions agains environmental conditions like humidity, vibration, pollution and high/low temperature during installation.

Use fuse (slow 250mA 250VAC) on mains/supply input of the device. Use appropriate cables for mains connections. Apply safety regulations during installation.

2

SET

SET

b.AL


C.dLY

P.Err


End Prog.


0..30 sec


%0..100

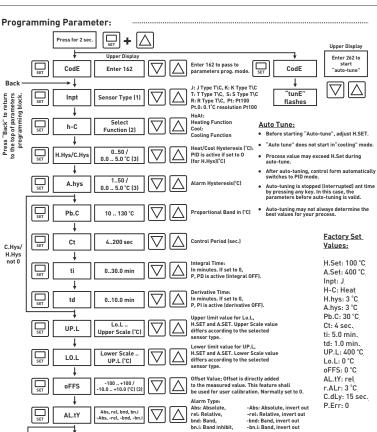


Programming Heat SET and Absolute Alarm SET:










A = H.SET-b.Alr, B = H.SET-b.Alr+A.hys, C = H.SET+b.Alr-A.hYS, D = H.SET+b.Alr

(*) AL.tY = bn.i is same as bnd except that if AL.tY = bn.i, ALARM is never ON before PV is in band. (**) AL.tY = -bn.i is always same as -bnd.

OUT Output (ON-OFF Control):

• ON-OFF is active wher "H.Hys" is other then 0.



PID Parameters:

- P, PI, PD, PID is active when "H.Hys" iss et 0 (only for heating; h-C is set to "HEAt").
- PbC: Proportional band in °C.
- Ct: Control period for PID control. Prefer 4-10 sec.
- $\underline{\textbf{Ti}}_{2}$ Integral time; Set in minutes. Determines how fast controller reacts to compansate the offset between SET point and the process value. If set to 0, integral part is OFF. If set too low, process value may oscillate.
- <u>Id:</u> Derivative time; Set in minutes. If set to 0, derivative parf is OFF. Determines how sensitive the controller is to changes of the offset between SET point and the process value. If set too high, process value may oscillate of overshoot.

bnd: Band, bn.i: Band inhibit,

Relative or band Alarm Value. Displayed if AL.tY is other ther

Active only in cooling mode.
Minimum delay before OUT becomes ON after it becomes OFF.

Determines the duty cycle of OUT output

when "Fail" message is displayed. If 0, 0UT is always 0FF
If 100, 0UT is always 0N, when device "fails". Period is Ct.